



**OVERFLOW**  
**SOLUTIONS**

# Domestic Roof Drainage Systems

An important consideration when designing a roof drainage system is to ensure that appropriate overflow measures are put in place in order to prevent water from flowing back into the building. This document has been developed to assist Rollsec customers with designing their roof drainage systems to ensure that they comply with the current Building Code of Australia (BCA).



## The National Construction Code 2016 (NCC2016) - New Overflow Requirements

The NCC2016 Volume 2 contains new overflow requirements for domestic eaves gutters. Performance requirements can be met by designing and installing gutters and downpipes for a Class 1 (eg. domestic residence) or Class 10 (eg. open carport) in accordance with acceptable construction practice described in section 3.5.2 of the NCC2016, or by designing in accordance with AS/NZS3500.3 or AS/NZS3500.5, or a Performance Solution as described in the NCC.

## Gutter Overflow Options

There are two options when designing your overflow systems:

1. Continuous system - this operates over the entire length of the gutter (eg. slotted gutter and/or controlled back gap using spacers).
2. Dedicated system - this collects and removes the overflow in a given location (eg. using a rainwater head).

A roof drainage designer can meet the overflow volumes by using either or a combination of the two options.

## Responsibilities of the Designer

It is the designer's responsibility to design a rainwater system which allows adequate drainage to occur. The designer may be an architect, a builder, a hydraulic engineer, a home owner, or a roofing or guttering contractor.

The design and installation of a rainwater system needs to comply with the NCC2016 requirements or the Building Code of Australia and Australian Standards AS/NZS 3500.3 Plumbing and Drainage, Stormwater Drainage or AS/NZS 3500.5 Plumbing and Drainage, Housing Installations.

## Responsibilities of the Installer

It is the installer's responsibility to ensure the rainwater system is installed as per the requirements outlined by the rainwater system's designer.

Adequate fall towards the downpipes must be given to gutters (a minimum of 1 in 500 for eaves gutters and 1 in 200 for internal gutters).

The installer must ensure that the correct number of downpipes of sufficient size are installed, that they are clear of debris and able to discharge correctly.

## Maintenance

To ensure longevity of your rainwater system and trouble-free performance, it is essential that regular maintenance takes place. Gutters must be regularly cleaned to prevent the build up of debris, fungus or any other materials that could block the flow of water from the roof.

# Queensland Rainfall

Information extracted from the NCC2016 Volume 2 and is relevant for Queensland.

Table 1

Rainfall Duration Intensities for Queensland		
Locality	5 minute duration rainfall intensity (mm/h)	
	Average recurrence interval (ARI), once in	
	20 years	100 years
Bamaga	252	298
Brisbane	234	305
Ipswich	211	278
Victoria Point	245	320
Bundaberg	265	340
Cairns	229	278
Cloncurry	218	278
Innisfail	248	301
Mackay	250	316
Mt Isa	199	260
Noosa Heads	258	331
Rockhampton	229	300
Toowoomba	203	268
Townsville	235	300
Weipa	239	283

# Overflow Volumes

Table 2

Overflow Volume for Continuous Measure (L/s/m)								
Design 5 minute duration rainfall intensity (mm/h)	Ridge to gutter length (m)							
	2	4	6	8	10	12	14	16
150	0.08	0.17	0.25	0.33	0.42	0.5	0.58	0.67
175	0.10	0.19	0.29	0.39	0.49	0.58	0.68	0.78
200	0.11	0.22	0.33	0.44	0.56	0.67	0.78	0.89
225	0.13	0.25	0.38	0.50	0.63	0.75	0.88	1.0
250	0.14	0.28	0.42	0.56	0.69	0.83	0.97	1.1
275	0.15	0.31	0.46	0.61	0.76	0.92	1.1	1.2
300	0.17	0.33	0.50	0.67	0.83	1.0	1.2	1.3
325	0.18	0.36	0.54	0.72	0.90	1.1	1.3	1.4
350	0.19	0.39	0.58	0.78	0.97	1.2	1.4	1.6
375	0.21	0.42	0.63	0.83	1.0	1.3	1.5	1.7
400	0.22	0.44	0.67	0.89	1.1	1.3	1.6	1.8

Table 3

Overflow Volume for Dedicated Measure (L/s)					
Design 5 minute duration rainfall intensity (mm/h)	Roof catchment area (m <sup>2</sup> )				
	30	40	50	60	70
150	1.3	1.7	2.1	2.5	2.9
175	1.5	1.9	2.4	2.9	3.4
200	1.7	2.2	2.8	3.3	3.9
225	1.9	2.5	3.1	3.8	4.4
250	2.1	2.8	3.5	4.2	4.9
275	2.3	3.1	3.8	4.6	5.3
300	2.5	3.3	4.2	5.0	5.8
325	2.7	3.6	4.5	5.4	6.3
350	2.9	3.9	4.9	5.8	6.8
375	3.1	4.2	5.2	6.3	7.3
400	3.3	4.4	5.6	6.7	7.8



# Continuous Overflow Solutions

The following overflow solutions provide a measure for continuous overflow for the full length in which the solution is applied. These can be applied in combination with dedicated measures if further overflow capacity is required.

## 150 Hi-Front Gutter (Slotted)

The bottom of the slots in the front face of the gutter should be a minimum of 25mm below the top of the fascia. The top edge of the back of the gutter should be 10mm minimum below the top of the fascia.



Overflow Capacity = 0.28L/s per outlet

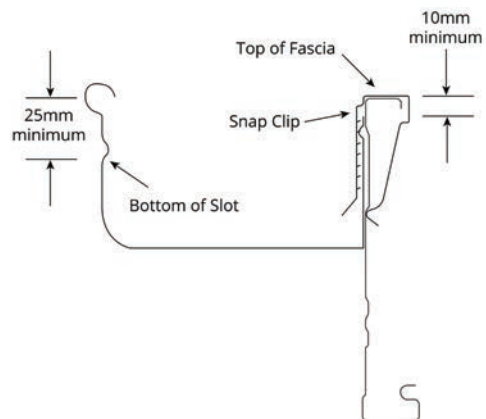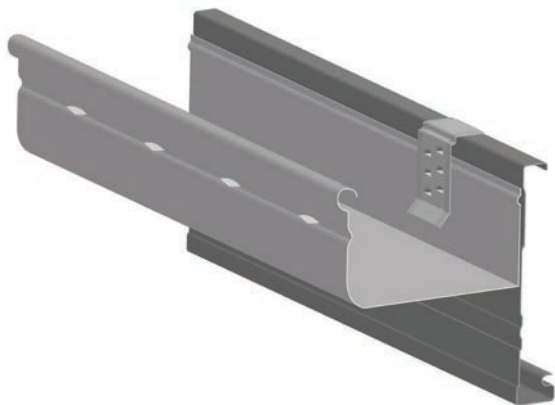

## 150 Hi-Flow Gutter (Slotted)

The bottom of the slots in the front face of the gutter should be a minimum of 25mm below the top of the fascia. The top edge of the back of the gutter should be 10mm minimum below the top of the fascia.

Overflow Capacity = 0.78L/s per outlet

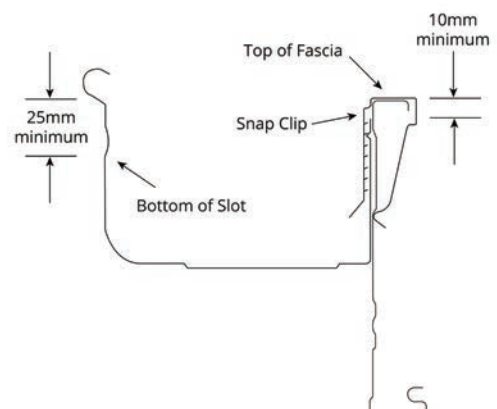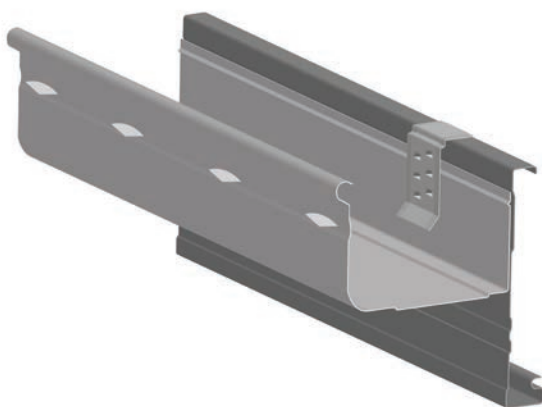


# Continuous Overflow Solutions


The following overflow solutions provide a measure for continuous overflow for the full length in which the solution is applied. These can be applied in combination with dedicated measures if further overflow capacity is required.

## Front Gutter Height

Water will overflow to the front of the gutter if the top of the front gutter bead is located below the top of the fascia. Due to the gutter fall, this may occur towards the end of a gutter run in, which case the portion of gutter beginning 5mm below the top of the fascia may be used in the overflow calculations.

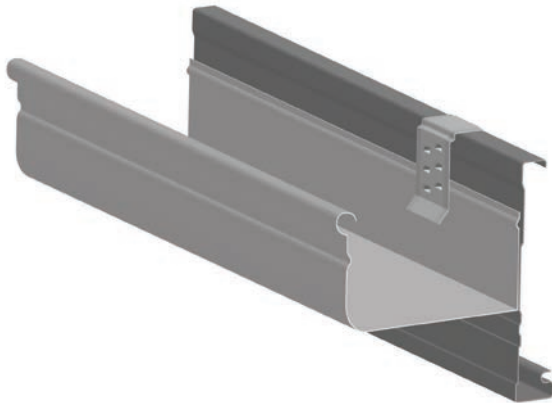


Dimension, X (mm)	Overflow Capacity (L/s/m)
$5 \leq x < 10$	0.6
$10 \leq x < 15$	1.5
$15 \leq x < 20$	3.4

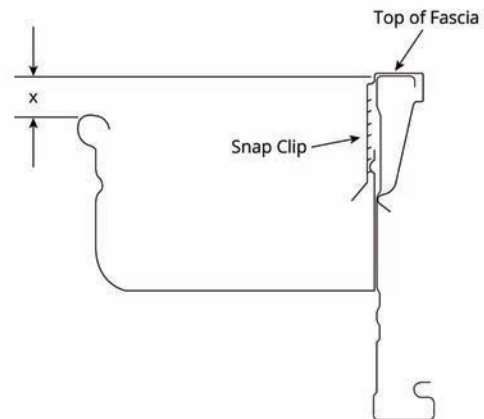


## Back Exit Gap

A spacer creates a consistent gap between the gutter and fascia and will allow water to escape through the gap without entering the building. Spacers are clipped to the back of the gutter at a maximum of 900mm centres. The back of the gutter shall be at least 10mm below the top of the fascia and the gap at least 1.5mm wide.

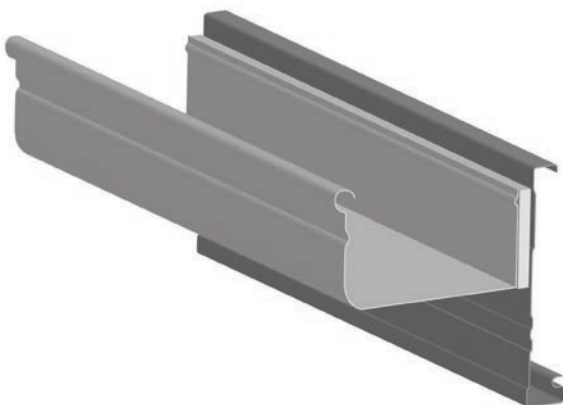

Average Back Exit Gap (mm)	Overflow Capacity (L/s/m)
1.5	1.20
3.0	1.40
4.5	1.50
6.0	1.55

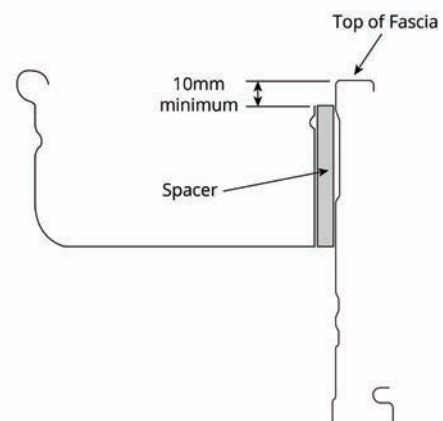



# Dedicated Overflow Solutions

The following overflow solutions will provide a dedicated overflow in litres per second for the individual measure. In some cases these measures can be located intermittently along the gutter to obtain the total overflow required or may be suitable as a stand-alone.

## Internal Outlet

An internal outlet with minimum dimensions of 100mm x 50mm positioned lengthways in the gutter will overflow water internally from the gutter once it reaches a certain level. The top of the outlet shall be located at least 25mm below the top of the fascia.



Overflow Capacity = 1.2L/s per outlet

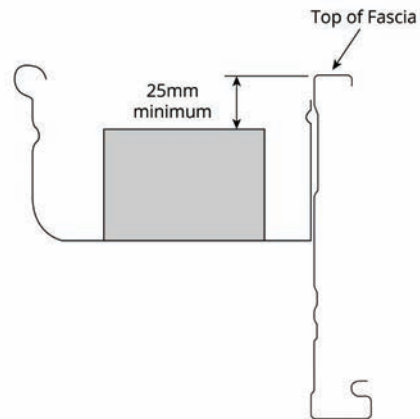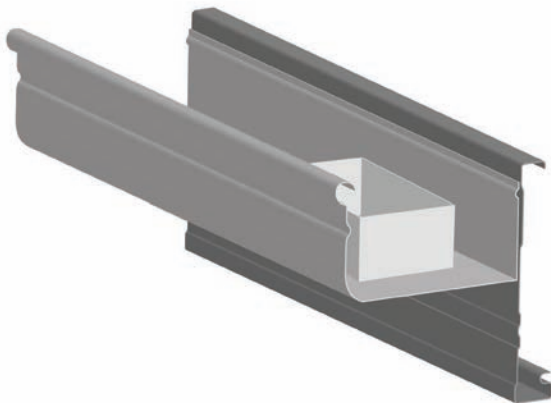

## Cut-Down Stop End

As long as it is not abutting a wall, a stop end which is cut down to create a weir will allow for some additional overflow. The cut-down shall be at least 100mm wide with the lower edge at least 25mm from the top of the fascia.

Overflow Capacity = 0.5L/s

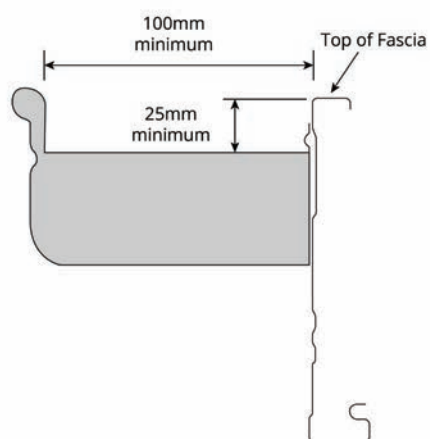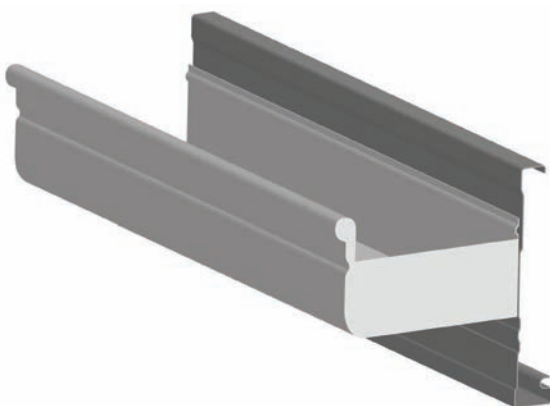


# Dedicated Overflow Solutions

## Front Face Cut-Down or Weir

A manually cut slot or cut-down at appropriate intervals in the front face of the gutter will remove overflow from the front of gutters. The lowest edge of the cut-out shall be at least 25mm below the top of the fascia and shall be minimum of 20mm deep.

Width, X (mm)	Overflow Capacity (L/s)
100	0.5
200	1.0

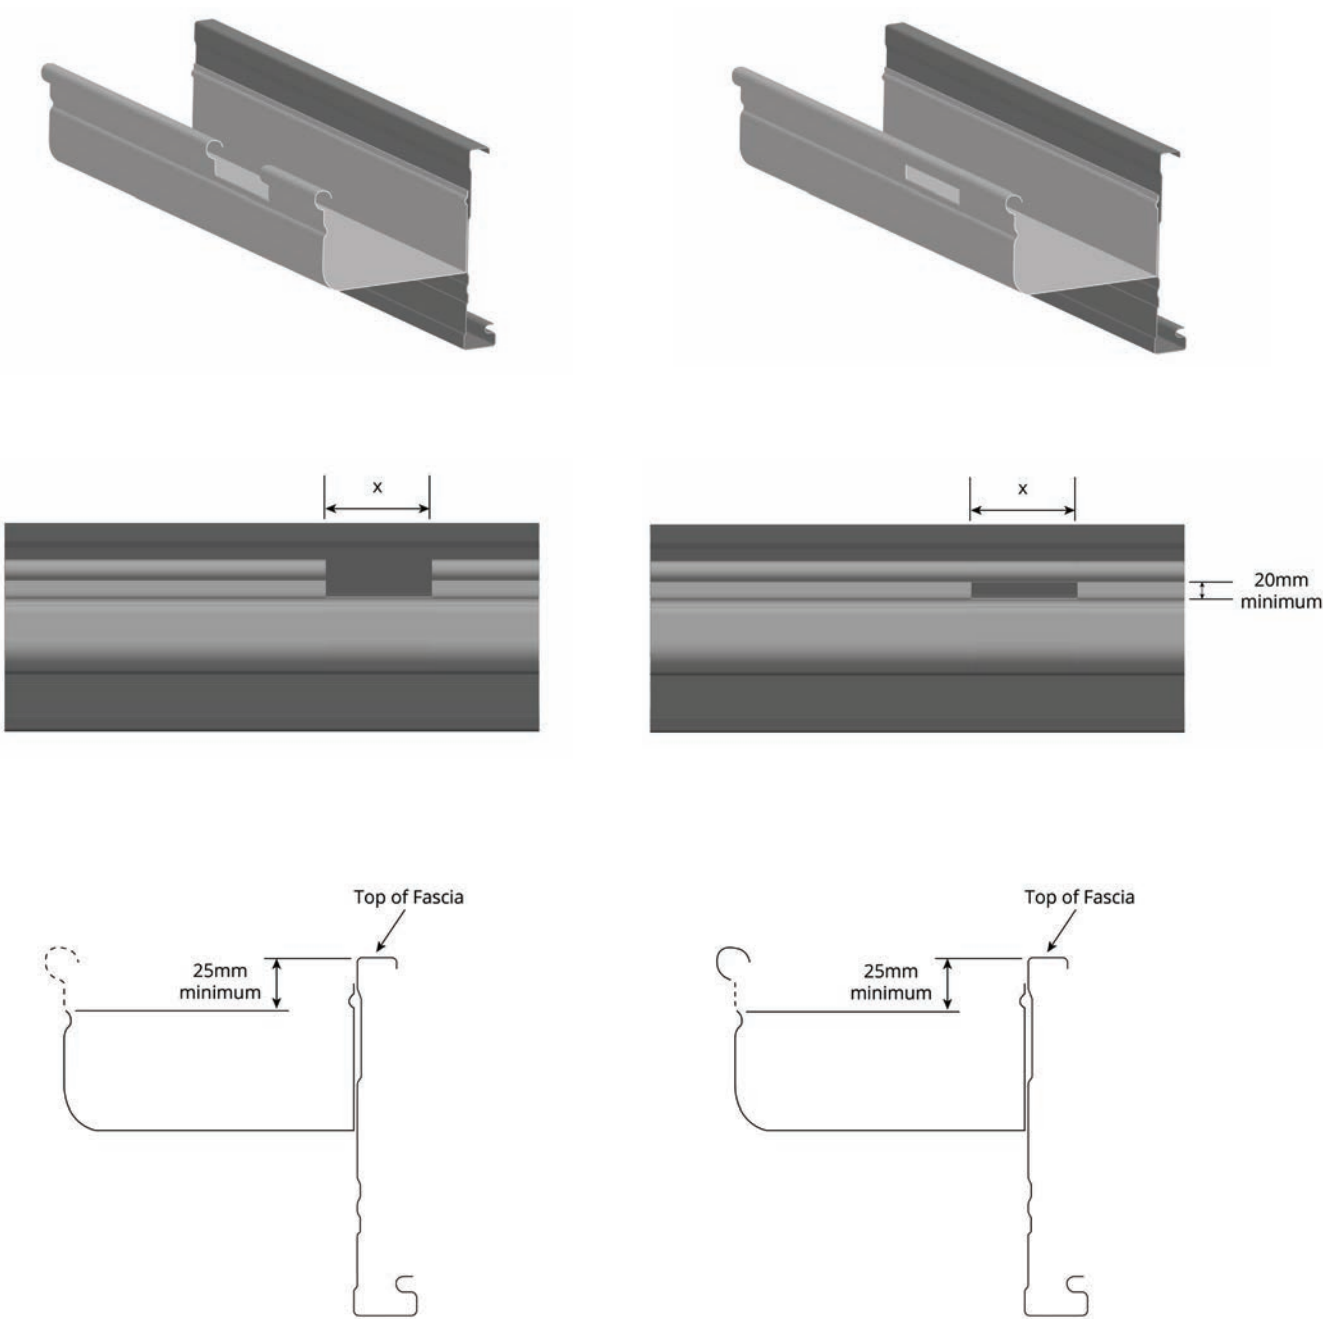



# Dedicated Overflow Solutions

## Domestic Rainhead




For a modern appeal, an aesthetically pleasing domestic rainhead can be selected to provide the full overflow allowance when designed appropriately. The overflow outlet in the rainhead shall be located at least 100mm from the top of the fascia with the base of the gutter at least 60mm from the top of the fascia.

Outlet/Slot Area, A  
 $A = \pi R^2$  (circular)

Distance, X (mm)	Minimum Gutter Outlet Area, $A_y$ (mm <sup>2</sup> )	Slot Area, $A_z$ (mm <sup>2</sup> )	Overflow Capacity (L/s)
100	4000	≥3000	2.5
	6000	4500	3.8
	8000	6000	5.1
125	5000	≥3000	2.8
	7000	4500	4.2
	9000	6000	5.7

Note: For intermediate values of area, interpolation is permitted.

## Circular Overflow

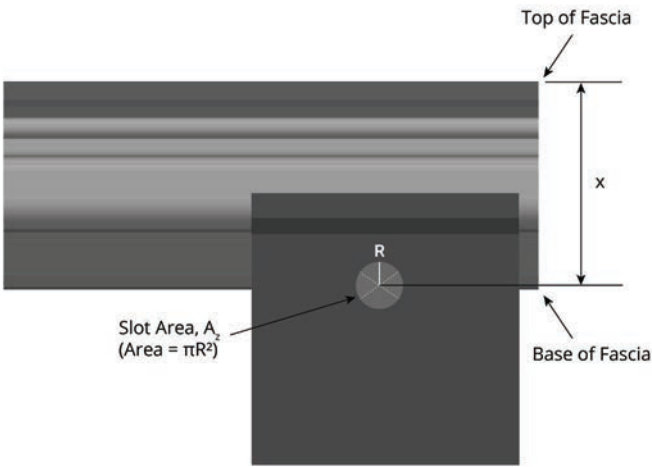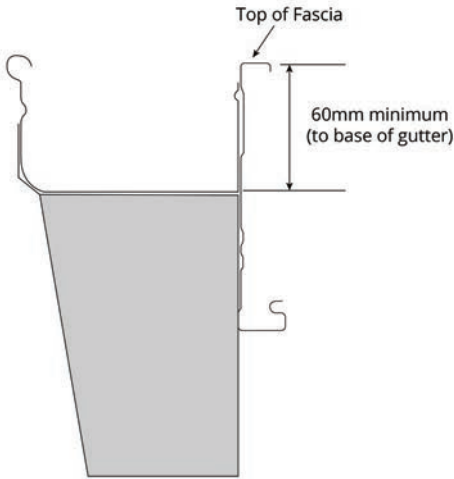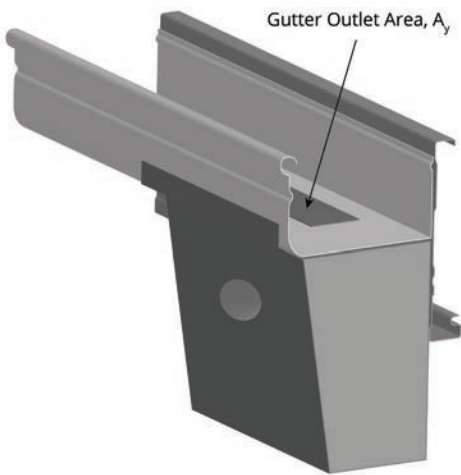

# Dedicated Overflow Solutions

## Domestic Rainhead




For a modern appeal, an aesthetically pleasing domestic rainhead can be selected to provide the full overflow allowance when designed appropriately. The overflow outlet in the rainhead shall be located at least 100mm from the top of the fascia with the base of the gutter at least 60mm from the top of the fascia.

Outlet/Slot Area, A  
 $A = B \times D$  (rectangular)

Distance, X (mm)	Minimum Gutter Outlet Area, $A_y$ (mm <sup>2</sup> )	Slot Area, $A_z$ (mm <sup>2</sup> )	Overflow Capacity (L/s)
100	4000	$\geq 3000$	2.5
	6000	4500	3.8
	8000	6000	5.1
125	5000	$\geq 3000$	2.8
	7000	4500	4.2
	9000	6000	5.7

Note: For intermediate values of area, interpolation is permitted.

## Rectangular Overflow

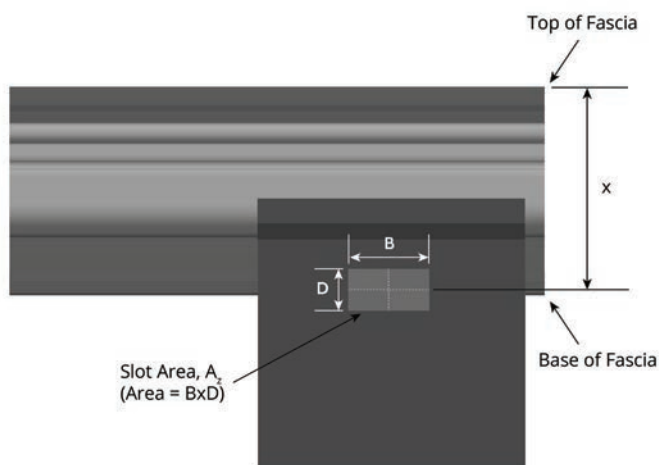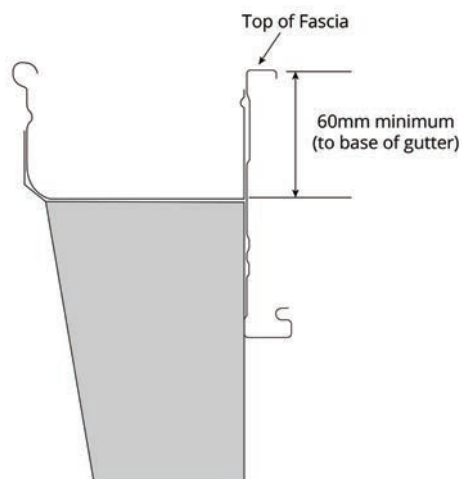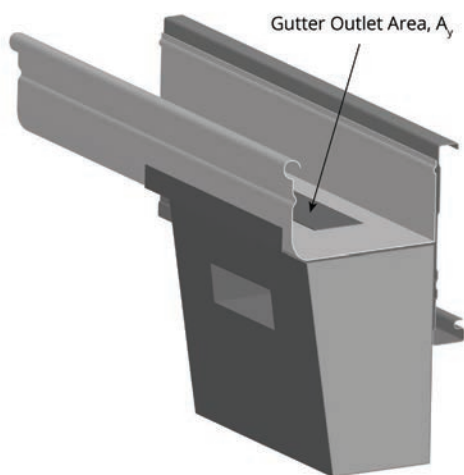

# Design Example

Looking at a home located in Brisbane, QLD. Determine the overflow requirement for a 10m eaves gutter length with a 6m Ridge to Gutter Length.

## Solution

### Step 1

From Table 1 as noted earlier, the 5 minute duration rainfall intensity for an average recurrence interval of 100 years in Brisbane is 305mm/h. Round this value up to the closest 25mm/h increment, i.e. 325mm/h

### Step 2

As we have the Ridge to Gutter Length of 5m, Table 2 is used to determine an interpolated value of 0.54L/s/m for a 325mm/h intensity. If required, the total overflow can be determined by multiplying this volume by the gutter length, i.e.  $0.54 \times 10\text{m} = 5.4\text{L/s}$ . Alternatively, if the Roof Catchment Area is known to be 60m<sup>2</sup>, Table 3 is used to determine an interpolated overflow volume of 5.4L/s for a 325mm/h intensity.

### Step 3


An appropriate overflow solution can now be determined for this 10m run of gutter:

#### Option 1: Continuous Overflow Solution

Consider a 4.5mm Rear Exit Gap.

For this option the Overflow Capacity = 1.5L/s/m (refer page 5).


As  $1.5 > 0.54\text{L/s/m}$  this is an acceptable solution.

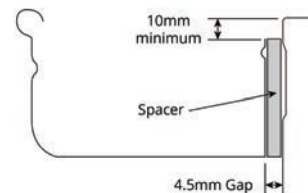

#### Option 2: Dedicated Overflow Solution

Consider an internal outlet of dimensions 100mm x 50mm positioned lengthways in the gutter. The distance from the top of the fascia to the top of the outlet measures 30mm which is larger than the required minimum of 25mm. For this option the Overflow Capacity = 1.2L/s/m (refer page 6).

As  $1.2 > 0.54\text{L/s}$  this is an acceptable solution.




#### Option 3: Combination Overflow Solution

It is determined for the final 4m at the low end, the Front Gutter Height will be between 5mm and 10mm below the top of the fascia.

This will provide an Overflow Capacity = 0.6L/s/m (refer page 4) and therefore an overflow of  $4\text{m} \times 0.6 = 2.4\text{L/s}$




Locate three equally spaced Front Face Weirs over the gutter length. Use 200mm width weirs which provide an Overflow Capacity = 1.0L/s each (refer page 6). This provides an overflow of  $3 \times 1.0 = 3.0\text{L/s}$

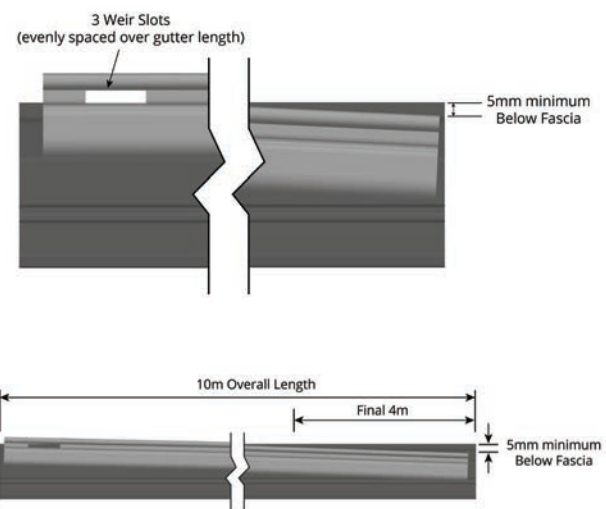The total overflow capacity for this combination:  $2.4\text{L/s} + 3.0\text{L/s} = 5.4\text{L/s}$  which is equal to the required overflow volume so this is an acceptable solution.



# Overflow Volumes

Rainfall Intensity (mm/h)		Ridge to gutter length (m)																								
		4	4.5	5	5.5	6	6.5	7	7.5	8	8.5	9	9.5	10	10.5	11	11.5	12	12.5	13	13.5	14	14.5	15	15.5	16
	125	0.14	0.16	0.17	0.19	0.21	0.23	0.24	0.26	0.28	0.30	0.31	0.33	0.35	0.36	0.38	0.40	0.42	0.43	0.45	0.47	0.49	0.50	0.52	0.54	0.56
	150	0.17	0.19	0.21	0.23	0.25	0.27	0.29	0.31	0.33	0.35	0.38	0.40	0.42	0.44	0.46	0.48	0.50	0.52	0.54	0.56	0.58	0.60	0.63	0.65	0.67
	175	0.19	0.22	0.24	0.27	0.29	0.32	0.34	0.36	0.39	0.41	0.44	0.46	0.49	0.51	0.53	0.56	0.58	0.61	0.63	0.66	0.68	0.70	0.73	0.75	0.78
	200	0.22	0.25	0.28	0.31	0.33	0.36	0.39	0.42	0.44	0.47	0.50	0.53	0.56	0.58	0.61	0.64	0.67	0.69	0.72	0.75	0.78	0.81	0.83	0.86	0.89
	225	0.25	0.28	0.31	0.34	0.38	0.41	0.44	0.47	0.50	0.53	0.56	0.59	0.63	0.66	0.69	0.72	0.75	0.78	0.81	0.84	0.88	0.91	0.94	0.97	1.0
Charlesville	238	0.26	0.30	0.33	0.36	0.40	0.43	0.46	0.50	0.53	0.56	0.60	0.63	0.66	0.69	0.73	0.76	0.79	0.83	0.86	0.89	0.93	0.96	0.99	1.02	1.06
Charters Towers	250	0.28	0.31	0.35	0.38	0.42	0.45	0.49	0.52	0.56	0.59	0.63	0.66	0.69	0.73	0.76	0.80	0.83	0.87	0.90	0.94	0.97	1.01	1.04	1.08	1.11
Longreach	251	0.28	0.31	0.35	0.38	0.42	0.45	0.49	0.52	0.56	0.59	0.63	0.66	0.70	0.73	0.77	0.80	0.84	0.87	0.91	0.94	0.98	1.01	1.05	1.08	1.12
Warwick	252	0.28	0.32	0.35	0.39	0.42	0.46	0.49	0.53	0.56	0.60	0.63	0.67	0.70	0.74	0.77	0.81	0.84	0.88	0.91	0.95	0.98	1.02	1.05	1.09	1.12
Goondiwindi	258	0.29	0.32	0.36	0.39	0.43	0.47	0.50	0.54	0.57	0.61	0.65	0.68	0.72	0.75	0.79	0.82	0.86	0.90	0.93	0.97	1.00	1.04	1.08	1.11	1.15
Mt Isa	260	0.29	0.33	0.36	0.40	0.43	0.47	0.51	0.54	0.58	0.61	0.65	0.69	0.72	0.76	0.79	0.83	0.87	0.90	0.94	0.98	1.01	1.05	1.08	1.12	1.16
Toowoomba	268	0.30	0.34	0.37	0.41	0.45	0.48	0.52	0.56	0.60	0.63	0.67	0.71	0.74	0.78	0.82	0.86	0.89	0.93	0.97	1.01	1.04	1.08	1.12	1.15	1.19
	275	0.31	0.34	0.38	0.42	0.46	0.50	0.53	0.57	0.61	0.65	0.69	0.73	0.76	0.80	0.84	0.88	0.92	0.95	0.99	1.03	1.07	1.11	1.15	1.18	1.22
Cairns	278	0.31	0.35	0.39	0.42	0.46	0.50	0.54	0.58	0.62	0.66	0.70	0.73	0.77	0.81	0.85	0.89	0.93	0.97	1.00	1.04	1.08	1.12	1.16	1.20	1.24
Cloncurry	278	0.31	0.35	0.39	0.42	0.46	0.50	0.54	0.58	0.62	0.66	0.70	0.73	0.77	0.81	0.85	0.89	0.93	0.97	1.00	1.04	1.08	1.12	1.16	1.20	1.24
Gympie	278	0.31	0.35	0.39	0.42	0.46	0.50	0.54	0.58	0.62	0.66	0.70	0.73	0.77	0.81	0.85	0.89	0.93	0.97	1.00	1.04	1.08	1.12	1.16	1.20	1.24
Proserpine	293	0.33	0.37	0.41	0.45	0.49	0.53	0.57	0.61	0.65	0.69	0.73	0.77	0.81	0.85	0.90	0.94	0.98	1.02	1.06	1.10	1.14	1.18	1.22	1.26	1.30
Rockhampton	300	0.33	0.38	0.42	0.46	0.50	0.54	0.58	0.63	0.67	0.71	0.75	0.79	0.83	0.88	0.92	0.96	1.00	1.04	1.08	1.13	1.17	1.21	1.25	1.29	1.33
Townsville	300	0.33	0.38	0.42	0.46	0.50	0.54	0.58	0.63	0.67	0.71	0.75	0.79	0.83	0.88	0.92	0.96	1.00	1.04	1.08	1.13	1.17	1.21	1.25	1.29	1.33
Innisfail	301	0.33	0.38	0.42	0.46	0.50	0.54	0.59	0.63	0.67	0.71	0.75	0.79	0.84	0.88	0.92	0.96	1.00	1.05	1.09	1.13	1.17	1.21	1.25	1.30	1.34
Brisbane	305	0.34	0.38	0.42	0.47	0.51	0.55	0.59	0.64	0.68	0.72	0.76	0.80	0.85	0.89	0.93	0.97	1.02	1.06	1.10	1.14	1.19	1.23	1.27	1.31	1.36
Mackay	316	0.35	0.40	0.44	0.48	0.53	0.57	0.61	0.66	0.70	0.75	0.79	0.83	0.88	0.92	0.97	1.01	1.05	1.10	1.14	1.19	1.23	1.27	1.32	1.36	1.40
	325	0.36	0.41	0.45	0.50	0.54	0.59	0.63	0.68	0.72	0.77	0.81	0.86	0.90	0.95	0.99	1.04	1.08	1.13	1.17	1.22	1.26	1.31	1.35	1.40	1.44
Noosa Heads	331	0.37	0.41	0.46	0.51	0.55	0.60	0.64	0.69	0.74	0.78	0.83	0.87	0.92	0.97	1.01	1.06	1.10	1.15	1.20	1.24	1.29	1.33	1.38	1.43	1.47
Southport	335	0.37	0.42	0.47	0.51	0.56	0.60	0.65	0.70	0.74	0.79	0.84	0.88	0.93	0.98	1.02	1.07	1.12	1.16	1.21	1.26	1.30	1.35	1.40	1.44	1.49
Bundaberg	340	0.38	0.43	0.47	0.52	0.57	0.61	0.66	0.71	0.76	0.80	0.85	0.90	0.94	0.99	1.04	1.09	1.13	1.18	1.23	1.28	1.32	1.37	1.42	1.46	1.51
	350	0.39	0.44	0.49	0.53	0.58	0.63	0.68	0.73	0.78	0.83	0.88	0.92	0.97	1.02	1.07	1.12	1.17	1.22	1.26	1.31	1.36	1.41	1.46	1.51	1.56

-  125 Squareline Gutter - Overflow volume 0.63L/s/m
-  150 Hi-Flow Gutter - Overflow volume 0.78L/s/m
-  With a 4mm spacer - Overflow volume 1.2L/s/m



17A/853 Nudgee Road, Northgate QLD 4013  
PO Box 1627, Toombul 4012  
P. +61 7 3267 7171 F. +61 7 3267 6080  
E. [sales@rollsec.com.au](mailto:sales@rollsec.com.au)  
[www.rollsec.com.au](http://www.rollsec.com.au)